



VIRGINIA - GEORGIA TRANSFORMER
ONE SOURCE-ONE COMMITMENT

A PORTFOLIO SELECTION COVERING A VARIETY OF APPLICATIONS

February 2026

CURRENT

Northwest Iowa Power Co-op

Le Mars Substation, IA
PPU – Power Distribution

Crafted in Roanoke, VA



Base MVA – 5.6
Top MVA – 7
kV Rating – 67,000 V Delta/12,470 Y-7,200 V

Berkshire Hathaway Energy

Gypsum Bk1, Las Vegas, NV
IOU – Power Distribution

Crafted in Pocatello, ID




Base MVA – 12
Top MVA – 22.4
kV Rating – 69/12.47

Kupper Engineering

Keystone Trade Center, Ambler, PA
C&I – Power Distribution

Crafted in Rincon, GA

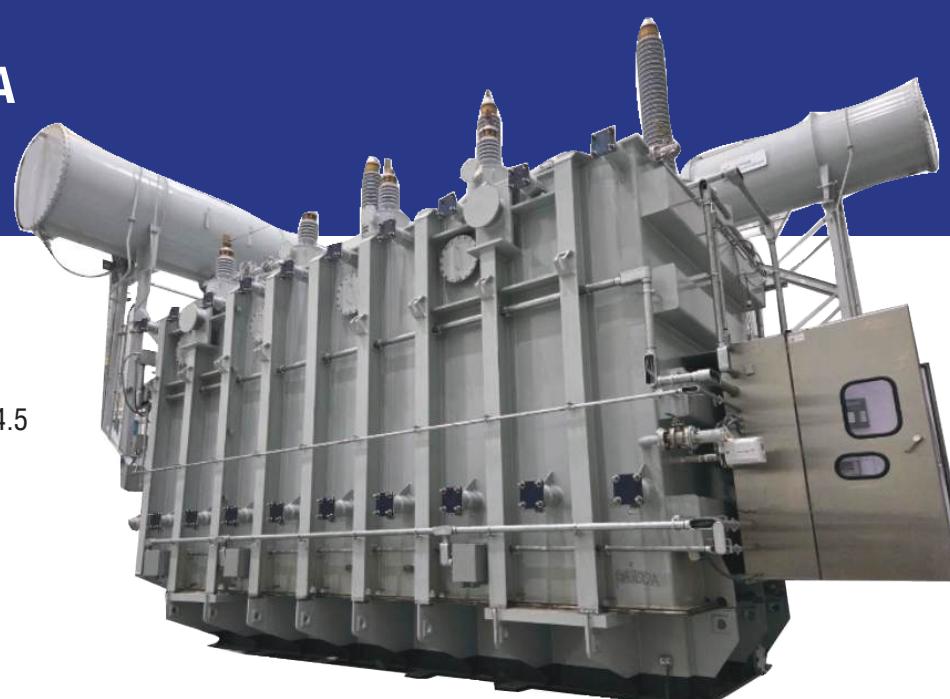

Base MVA – 134
Top MVA – 150
kV Rating – 230/34.5

Saber Power Services

Vaquero Midstream – Cryo Train 3
Oil & Gas – Power Distribution

Crafted in P1 - Chihuahua, MX



Base MVA – 3.75
Top MVA – 5.25
kV Rating – 4.16/0.48

Mission Critical Data Center

Data Center – Power Distribution
Crafted in P2 - Chihuahua, MX



Base MVA 2.5
Top MVA – 2.5
kV Rating – 34.5/0.48