



VIRGINIA TRANSFORMER CORP
The Commitment Company

A PORTFOLIO SELECTION COVERING A VARIETY OF APPLICATIONS

August 2026

CURRENT

Saber Power
Chemical Plant, TX
C&I — Power Distribution
Crafted in Roanoke, VA



*Base MVA – 10
Top MVA – 14
kV Rating – 138/4.16*

Volunteer Electric Co-Op
Substation, TN
PPU — Power Distribution
Crafted in Pocatello, ID



*Base MVA – 25
Top MVA – 46.667
kV Rating – 161/26.18*

Burns & McDonnell
Plano, IL
Data Center — Power Distribution
Crafted in Rincon, GA




*Base MVA – 120
Top MVA – 200.4
kV Rating – 345/34.5*

Banta Carbona Irrigation
Substation, CA
PPU — Power Distribution
Crafted in P1, Chihuahua, MX



*Base MVA – 7.5
Top MVA – 8.4
kV Rating – 60/12.47*

Rosendin Electric
Substation, CA
EPC — Power Distribution
Crafted in P2, Chihuahua, MX

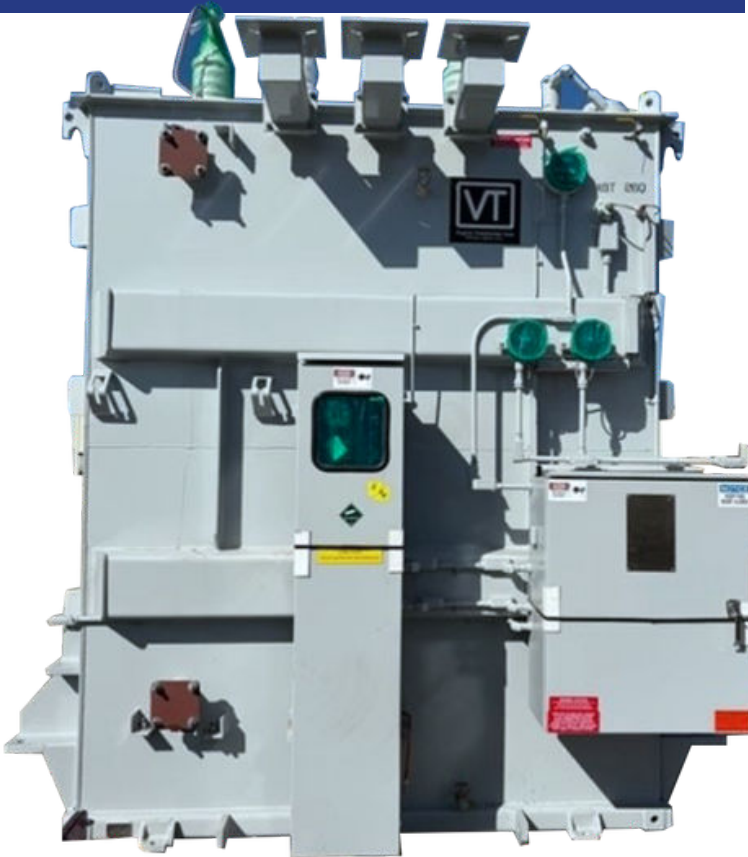

*Base MVA – 60
Top MVA – 100
kV Rating – 117.5/34.5*